




**Power System
Services**


MV SPARES

suitable for Nxair Panel VCB Type
3AE1 & 3AE5 12kV Rating 25 / 31.5 /
40kA 800A to 2500A

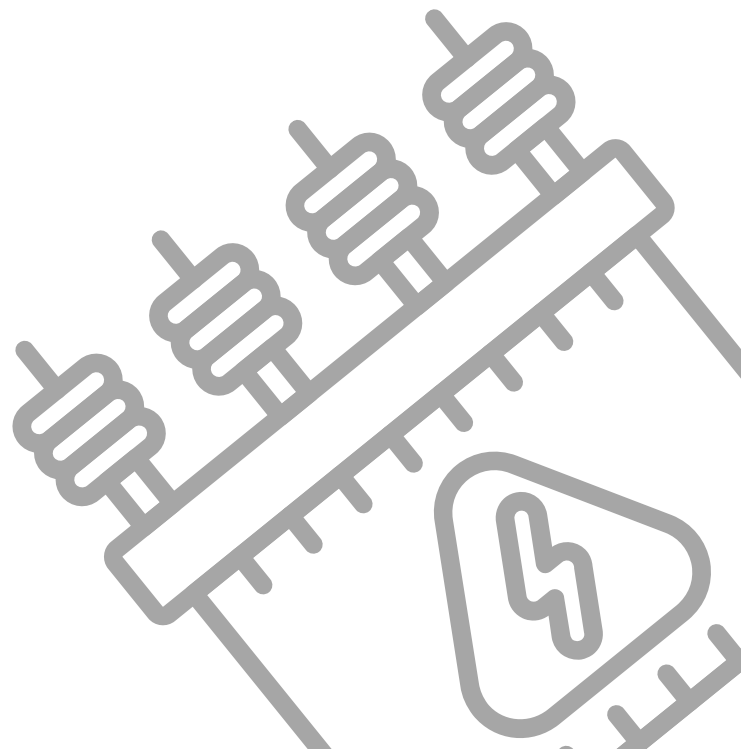





Pole Spares 3AK6 12kV, 40/44kA, 1250 Amp for one VCB

Sr. No.	Product Descriptions	Rating	Images
1	Operating Solenoid Coil 3AY15	24 V to 250V DC	
2	Operating Solenoid Coil 3AY15	100/125 V AC, 50/60Hz	
3	Drive Motor for 3AE 1 3AY17	24 / 30 / 32 V to 60V DC	
4	Drive Motor for 3AE 1 3AY17	100 / 110 / 125 V DC / AC	
5	Drive Motor for 3AE 1 3AY17	220 V DC / 230 V AC	
6	Agni Motor 110 VDC	110 – 127 V DC 100 – 125 V AC	
7	Agni Motor 220 VDC	220 – 240 V DC 220 – 240 V AC	
8			



Electrical Components commonly used in 3AE5






Sr. No.	Product Descriptions	Rating	Images
1	Operating Solenoid Coil 3AY14	24 V to 240V DC	
2	Operating Solenoid Coil 3AY14	100/125 V AC and 230/240 V AC 50/60Hz	
3	Drive Motor for 3AE5 3AY14	24 V to 60V DC	
4	Drive Motor for 3AE5 3AY14	100 / 110 / 125 V DC / AC	
5	Drive Motor for 3AE5 3AY14	220 V DC / 230 V AC	

Electrical Components commonly used in 3AE1 & 3AE5 India make products

Sr. No.	Product Descriptions	Rating	Images
1	2ND SHUNT REL 24 to 220 DC	3AX1101	 
2	2ND SHUNT REL100-110V AC 50Hz	3AX1101	
3	2ND SHUNT REL 230V AC 50Hz	3AX1101	
4	CTOPERAT. RELEASE0.5A	3AX1102	 
5	Under Voltage Coil 24V to 220V DC	3AX1103	
6	U/V REL 100V to 230V AC, 50HZ	3AX1103	
7	Limit (Snap) switch	Minimum Order Qty of 5 Nos.	




Pole Spares 3AK6 12kV, 40/44kA, 2500/3150A Amp for one VCB

Sr. No.	Product Descriptions	Rating	Images
1	Auxiliary switch 12NO+12NC	Installation At Switch Off Block	
2	Test / Service Position switch	Installation at Drive Box	
3	Male Pin for 64 Assembly		
4	Female Pin for 64 Assembly		
5	64 Plug Pin Assembly		



Pole Spares 3AK6 12kV, 40/44kA, 4000 Amp for one VCB

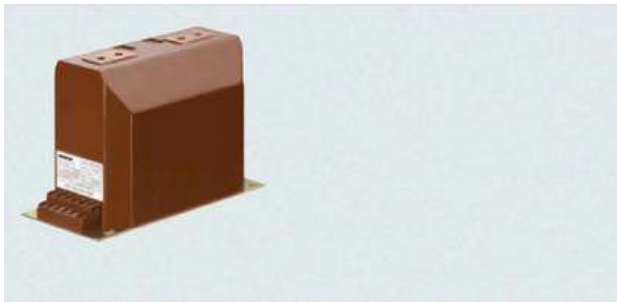

Current Transformer



Potential Transformer



IUBS plate



Pannel Operationsl Kit